



MỤC LỤC

BÁO CHÁY KHÔNG DÂY

Báo cháy cục bộ liên kết

Báo cháy cục bộ liên kết có kết nối điện thoại



CÔNG TY CỔ PHẦN AI SAFE

Địa chỉ: Tầng 4, 15 Tố Hữu, Thanh Xuân, Hà nội

Hotline: 0339.001.114/ 0868.001.114

Email: AiSafe.jsc@gmail.com

Web: Aisafe.vn/ Aisafe.com.vn

BÁO CHÁY CỤC BỘ

ĐẠT TIÊU CHUẨN EN14604:2005



PIN LITHIUM SỬ DỤNG 10 NĂM



THIẾT BỊ BẢO CHÁY CỤC BỘ LIÊN KẾT

Khi có 1 thiết bị phát hiện đám cháy thì các thiết bị được liên kết với nhau
Cùng phát tín hiệu báo cháy.



THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT

Mỗi một toà nhà có thể lắp đặt lên tới 30 thiết bị báo cháy



KẾT NỐI 30 THIẾT BỊ



THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT

Âm thanh cảnh báo lớn (85dB/3m)



Báo động bằng cả
Còi và Đèn chớp



Pin sử dụng 10 năm



Cảnh báo Pin yếu

Điều khiển từ xa

Thiết bị có một nút bấm để thử/tắt tiếng thiết bị báo cháy từ xa.



THIẾT BỊ BẢO CHÁY CỤC BỘ LIÊN KẾT



Thông Số Kỹ Thuật	Chi Tiết
Model	S100B-CR-RF / Đầu báo khói cục bộ liên kết
Cảm Biến	Phát xạ kép và một thu nhận hồng ngoại điện quang
Dòng chờ	<25μA
Dòng báo động	<150mA
Âm lượng báo động	>85dB ở 3m
Đèn báo	Đèn LED đỏ
Tự kiểm tra	Khoảng 40s
Cảnh báo pin yếu	2.5V±0.1V
Nhiệt độ hoạt động	-10°C~+50°C
Vật liệu	ABS-PC
Pin	CR17450 lithium battery
Màu sắc	Trắng
Kích thước	Ø102*H37mm
Đóng gói	Hộp trắng (105145120mm)
Lắp đặt	Lắp trần
Ứng dụng	TUYA/Smartlife
Tần số	433.92MHz/868.4MHz
Số lượng trong nhóm	30pcs (trong vòng 50m)
Khoảng cách lắp đặt	60 mét vuông cho một cái
Chứng chỉ chất lượng	CE-CPR/CE-RED/RoHS/UKCA/FCC



Kết nối không dây



Pin 10 năm



Dễ dàng lắp đặt



Cảnh báo pin yếu



Kiểm soát 360 độ



Kết nối đến 30 thiết bị

THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT CÓ KẾT NỐI ĐIỆN THOẠI

Khi có 1 thiết bị phát hiện đám cháy thì các thiết bị được liên kết với nhau
Cùng phát tín hiệu báo cháy.




THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT CÓ KẾT NỐI ĐIỆN THOẠI

Mỗi một toà nhà có thể lắp đặt lên tới 30 thiết bị báo cháy



KẾT NỐI 30 THIẾT BỊ

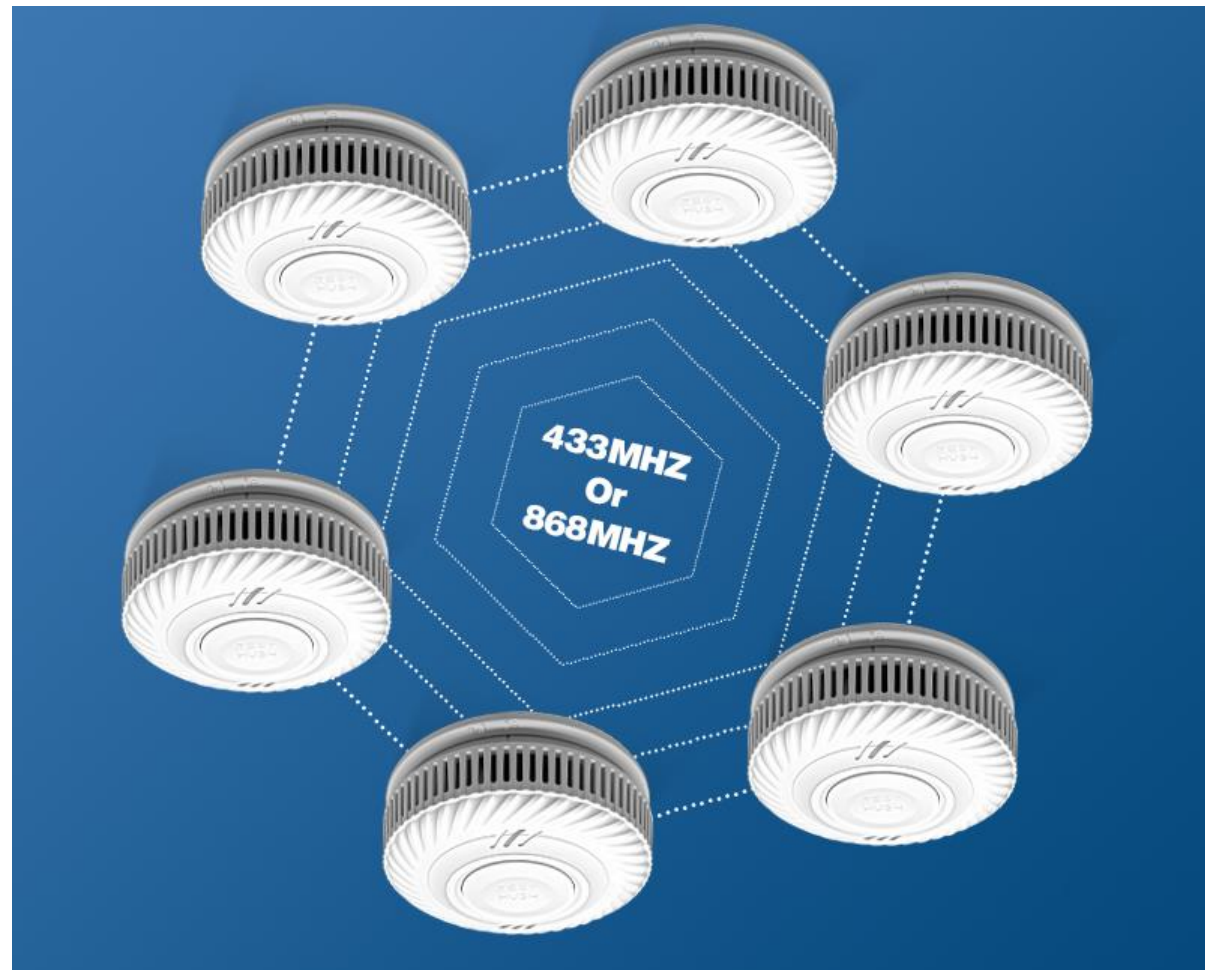

THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT CÓ KẾT NỐI VỚI ĐIỆN THOẠI

Âm thanh cảnh báo lớn (85dB/3m)



Báo động bằng cả
Còi và Đèn chớp



Pin sử dụng 10 năm



Cảnh báo Pin yếu


Điều khiển từ xa

Thiết bị có nút bấm để thử/tắt thiết bị báo cháy từ xa



THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT CÓ KẾT NỐI ĐIỆN THOẠI

KẾT NỐI VỚI ĐIỆN THOẠI BẰNG ỨNG DỤNG TUYA/ SMART LIFE

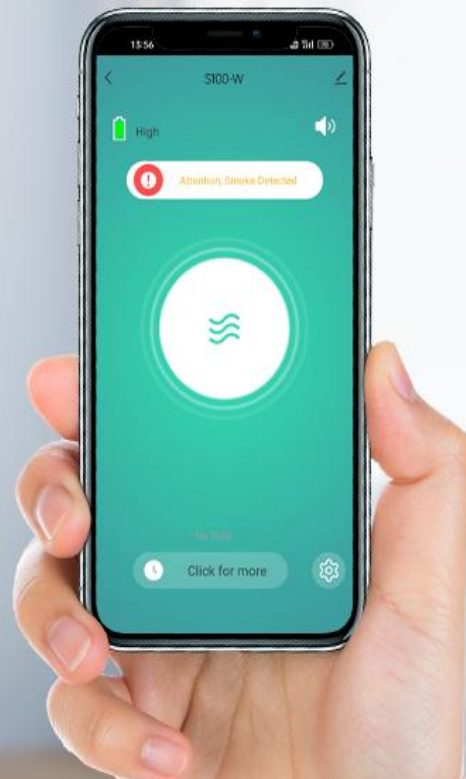

An toàn, Tiện lợi, Kiểm soát linh hoạt an ninh nhà bạn bất cứ lúc nào, bất cứ nơi đâu.

Kết nối Wi-Fi qua 2.4 GHz

Cho phép bạn dễ dàng kiểm tra tất cả thông tin liên quan về bộ phát hiện khói




2.4 GHz



Wifi và Zigbee kết nối

Kết nối với bạn qua mạng Wifi/Zigbee
tới các thiết bị bằng ứng dụng
Smart life/Tuya sẵn có.

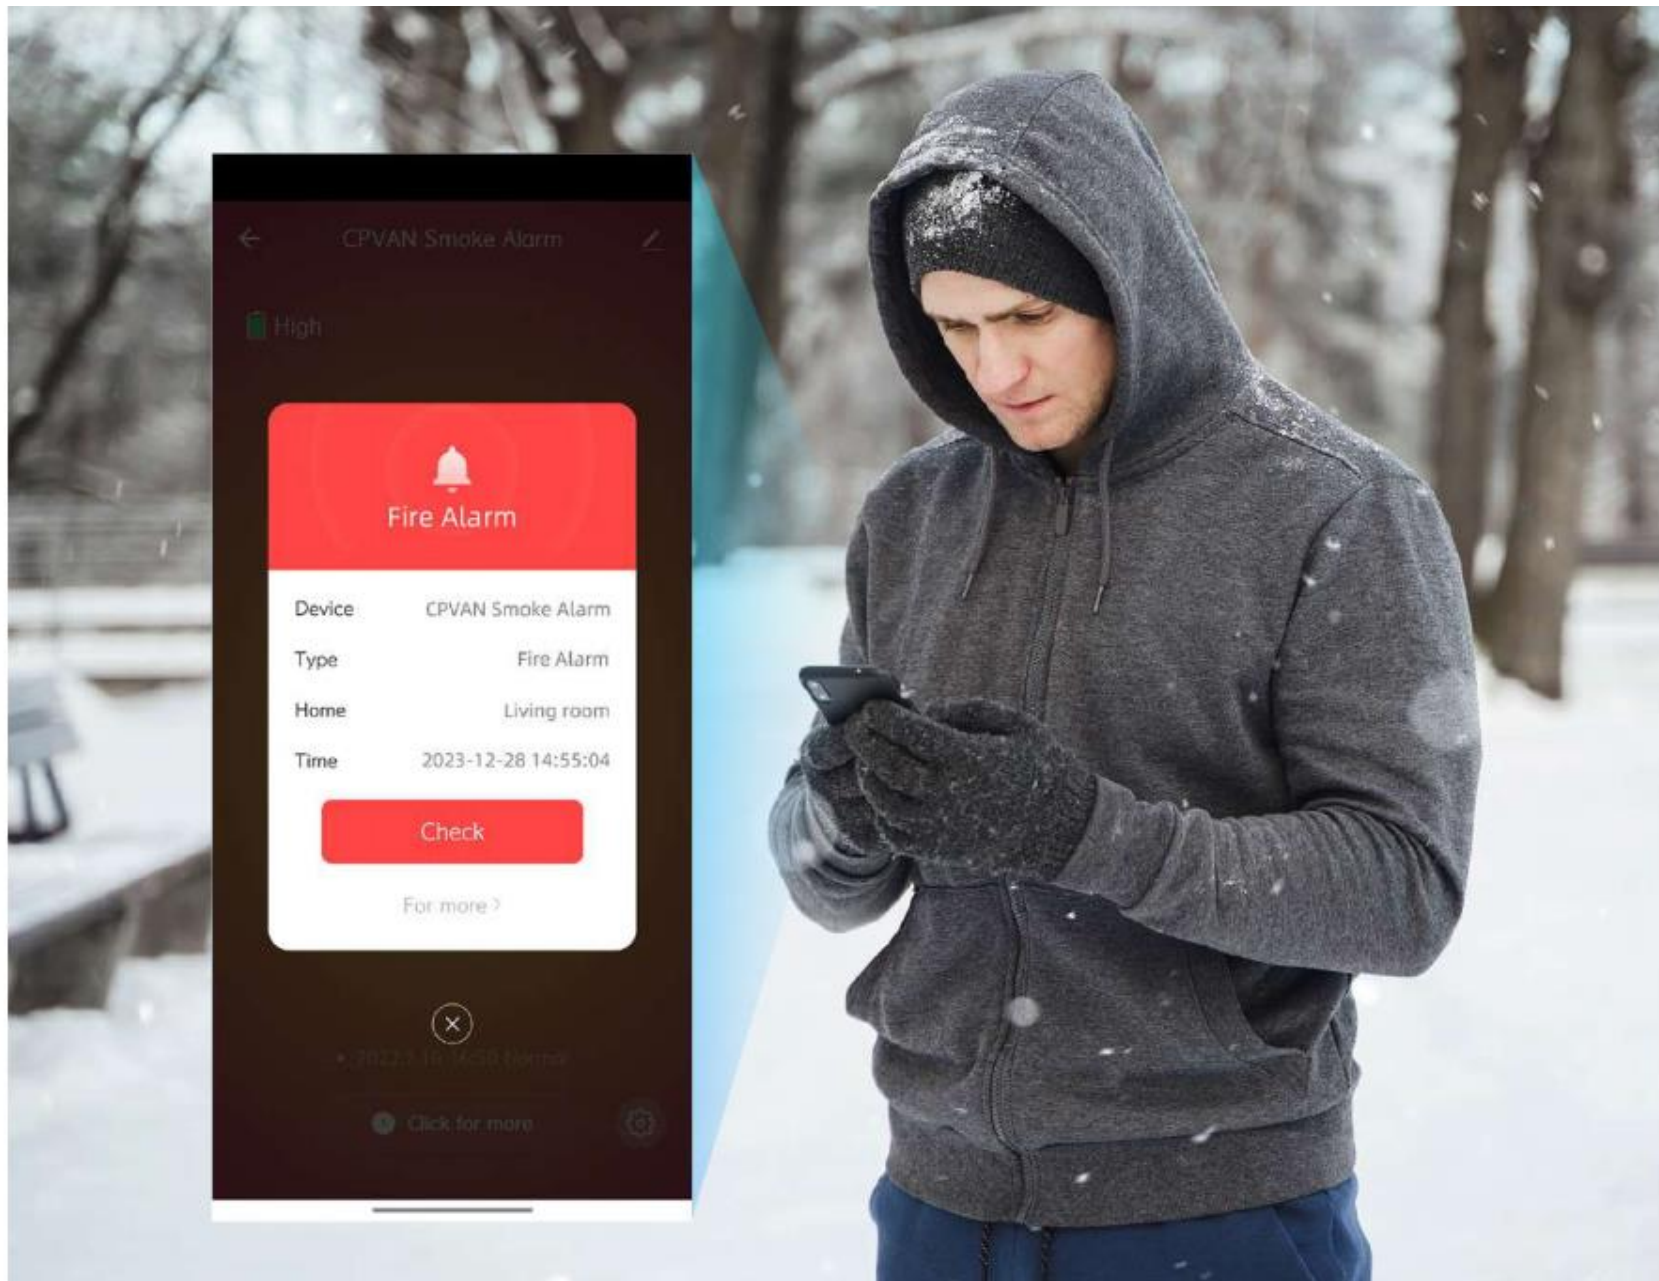

THIẾT BỊ BÁO CHÁY CỤC BỘ LIÊN KẾT CÓ KẾT NỐI ĐIỆN THOẠI



Mô tả Mục	Chi tiết
Mã Sản phẩm / Mô tả	S100B-CR-WIFI+RF/ Đầu báo khói cục bộ liên kết có kết nối điện thoại
Cảm biến	Phát xạ kép và nhận cảm biến hồng ngoại điện quang
Dòng chờ	<25μA
Dòng báo động	<150mA
Âm lượng báo động	>85dB ở 3m
Đèn báo động	Đèn LED đỏ
Tự kiểm tra	Khoảng 36s
Cảnh báo năng lượng thấp	2.5V±0.1V
Nhiệt độ hoạt động	-10°C~+50°C
Vật liệu	ABS-PC
Pin bao gồm	Có
Loại và số lượng pin	Pin lithium CR17450
Màu	Trắng
Kích thước (C x R x D)	Ø102*H37mm
Loại đóng gói	Hộp trắng (105145120mm)
Phương pháp lắp đặt	Lắp trên trần
Ứng dụng	TUYA/Smartlife
Tần số	433.92MHz/868.4MHz
Số lượng trong một nhóm	30pcs (trong phạm vi 50m)
Khoảng cách lắp đặt	60 mét vuông cho một cái
Chứng chỉ chất lượng	CE-CPR/CE-RED/RoHS/UKCA/FCC



Kết nối không dây



Pin 10 năm



Dễ dàng lắp đặt



Cảnh báo pin yếu



Kiểm soát 360 độ




Kết nối đến 30 thiết bị



Đầu báo khói cục bộ liên kết



Đầu báo nhiệt cục bộ liên kết

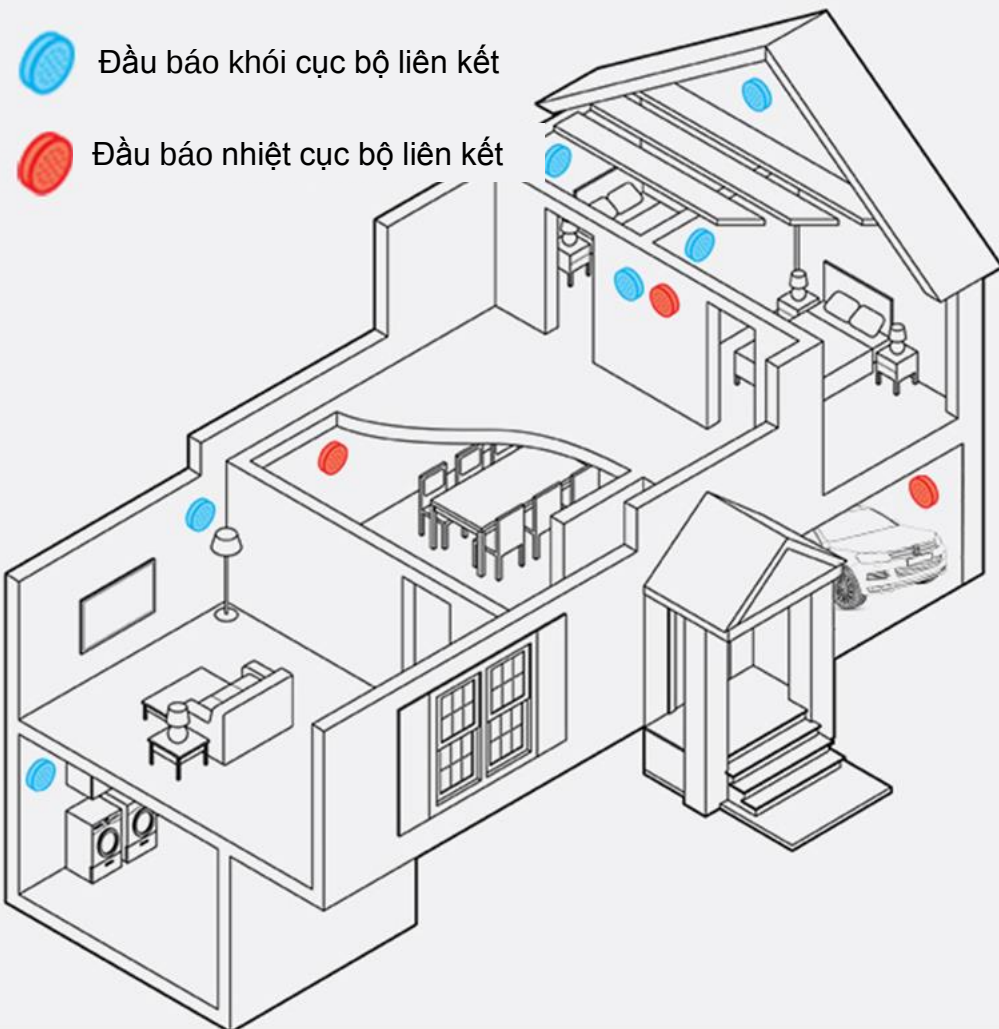


VỊ TRÍ LẮP ĐẶT

Lắp đặt ít nhất một thiết bị báo khói cục bộ liên kết trên mỗi tầng. Luôn lắp đặt thiết bị báo khói và báo nhiệt cục bộ liên kết ở vị trí trung tâm nhất như dưới trần nhà, cách tường hoặc đèn tối thiểu 50 cm.

ĐẸ DÀNG LẮP ĐẶT

Đễ dàng lắp đặt và cài đặt, có đủ các phụ kiện để lắp đặt đi kèm và mang lại sự yên tâm

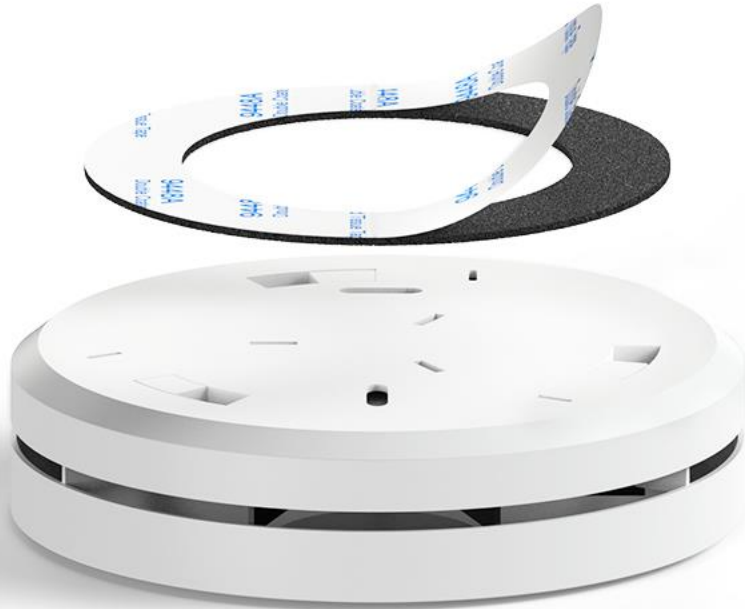

or



MANG TỚI SỰ YÊN TÂM

Mang lại cho bạn sự yên tâm bằng cách cảnh báo về các nguy cơ cháy nổ tiềm ẩn trong thời gian thực.



CHIA SẺ THÔNG TIN VỚI GIA ĐÌNH BẠN VỚI THỜI GIAN THỰC

Nhận thông tin thời gian thực về báo cháy, ở bất cứ đâu bạn và gia đình bạn đang ở trên thế giới.



Works with
Tuya



Works with
Smart Life



GIẤY CHỨNG NHẬN EN 14604 PHÙ HỢP VỚI QUY ĐỊNH VIỆT NAM

Certificate of constancy of performance		
according to Regulation (EU) No. 305/2011		
Certificate No.:	1008-CFR-MC 69266971 0001	
Report No.:	MU23AD9T 001	
Applicant:	Shenzhen Ariza Electronic Co., Ltd 201, Building B-1, Xinfu Industry Zone, Chongqing Road, Heping Community, Fuhai Street, Bao'an District, Shenzhen, Guangdong, P.R. China	
Manufacturer:	Shenzhen Ariza Electronic Co., Ltd 201, Building B-1, Xinfu Industry Zone, Chongqing Road, Heping Community, Fuhai Street, Bao'an District, Shenzhen, Guangdong, P.R. China	
Manufacturing plant:	Shenzhen Ariza Electronic Co., Ltd 201, Building B-1, Xinfu Industry Zone, Chongqing Road, Heping Community, Fuhai Street, Bao'an District, Shenzhen, Guangdong, P.R. China	
Product:	Photoelectric smoke alarms	
Identification:	S100X-AA, S100X-AA-W(y+z) Smart photoelectric smoke alarms Intended use: Fire safety FPC Report No.: MU23EX8R 001 Test report No.: CH23EX9M1 001	
System of assessment and verification:	1	
Tested according to:	EN 14604: 2005 EN 14604: 2005/ AC:2008	
This certificate attests that all provisions concerning the assessment and verification of constancy of performance and the performance described in Annex of the above standard(s) under above system are applied and the product fulfils all the prescribed requirements set out above. This certificate was first issued on 2023-12-20 and it will remain valid until the test methods and/or factory production control requirements included in the standard, used to assess the performance of the declared characteristics, and the product, and the manufacturing conditions in the plant are unchanged. The manufacturing plant and factory production control system of the manufacturer is supervised regularly by the Certification Body.		
Certification Body		
Date of issue:	 László Kovács	
TÜV Rheinland InterCert Kft, Product Certification Body — H-1143 Budapest, Gízafu út 51-57. — www.tuv.com Product certification body accredited by NAM under No. NAH-6-0553/2023/M, Notified Body No. 1008		
Validity of certificate can be checked on www.CERTIPEDIA.com		

Certificate of constancy of performance		
according to Regulation (EU) No. 305/2011		
Certificate No.:	1008-CFR-MC 69266971 0001	
Report No.:	MU23AD9T 001	
Applicant:	Shenzhen Ariza Electronic Co., Ltd 201, Building B-1, Xinfu Industry Zone, Chongqing Road, Heping Community, Fuhai Street, Bao'an District, Shenzhen, Guangdong, P.R. China	
Manufacturer:	Shenzhen Ariza Electronic Co., Ltd 201, Building B-1, Xinfu Industry Zone, Chongqing Road, Heping Community, Fuhai Street, Bao'an District, Shenzhen, Guangdong, P.R. China	
Manufacturing plant:	Shenzhen Ariza Electronic Co., Ltd 201, Building B-1, Xinfu Industry Zone, Chongqing Road, Heping Community, Fuhai Street, Bao'an District, Shenzhen, Guangdong, P.R. China	
Product:	Photoelectric smoke alarms	
Identification:	S100X-CH, S100X-CH-W(y+z) Smart photoelectric smoke alarms Intended use: Fire safety FPC Report No.: MU23EX8R 001 Test report No.: CH23EX9M1 001	
System of assessment and verification:	1	
Tested according to:	EN 14604: 2005 EN 14604: 2005/ AC:2008	
This certificate attests that all provisions concerning the assessment and verification of constancy of performance and the performance described in Annex of the above standard(s) under above system are applied and the product fulfils all the prescribed requirements set out above. This certificate was first issued on 2023-12-20 and it will remain valid until the test methods and/or factory production control requirements included in the standard, used to assess the performance of the declared characteristics, and the product, and the manufacturing conditions in the plant are unchanged. The manufacturing plant and factory production control system of the manufacturer is supervised regularly by the Certification Body.		
Certification Body		
Date of issue:	 László Kovács	
TÜV Rheinland InterCert Kft, Product Certification Body — H-1143 Budapest, Gízafu út 51-57. — www.tuv.com Product certification body accredited by NAM under No. NAH-6-0553/2023/M, Notified Body No. 1008		
Validity of certificate can be checked on www.CERTIPEDIA.com		



CÔNG TY CỔ PHẦN AI SAFE

Địa chỉ: Tầng 4, 15 Tố Hữu, Thanh Xuân, Hà nội

Hotline: 0339.001.114/ 0868.001.114

Email: AiSafe.jsc@gmail.com

Web: Aisafe.vn/ Aisafe.com.vn